Planning the best installation for your Clinic
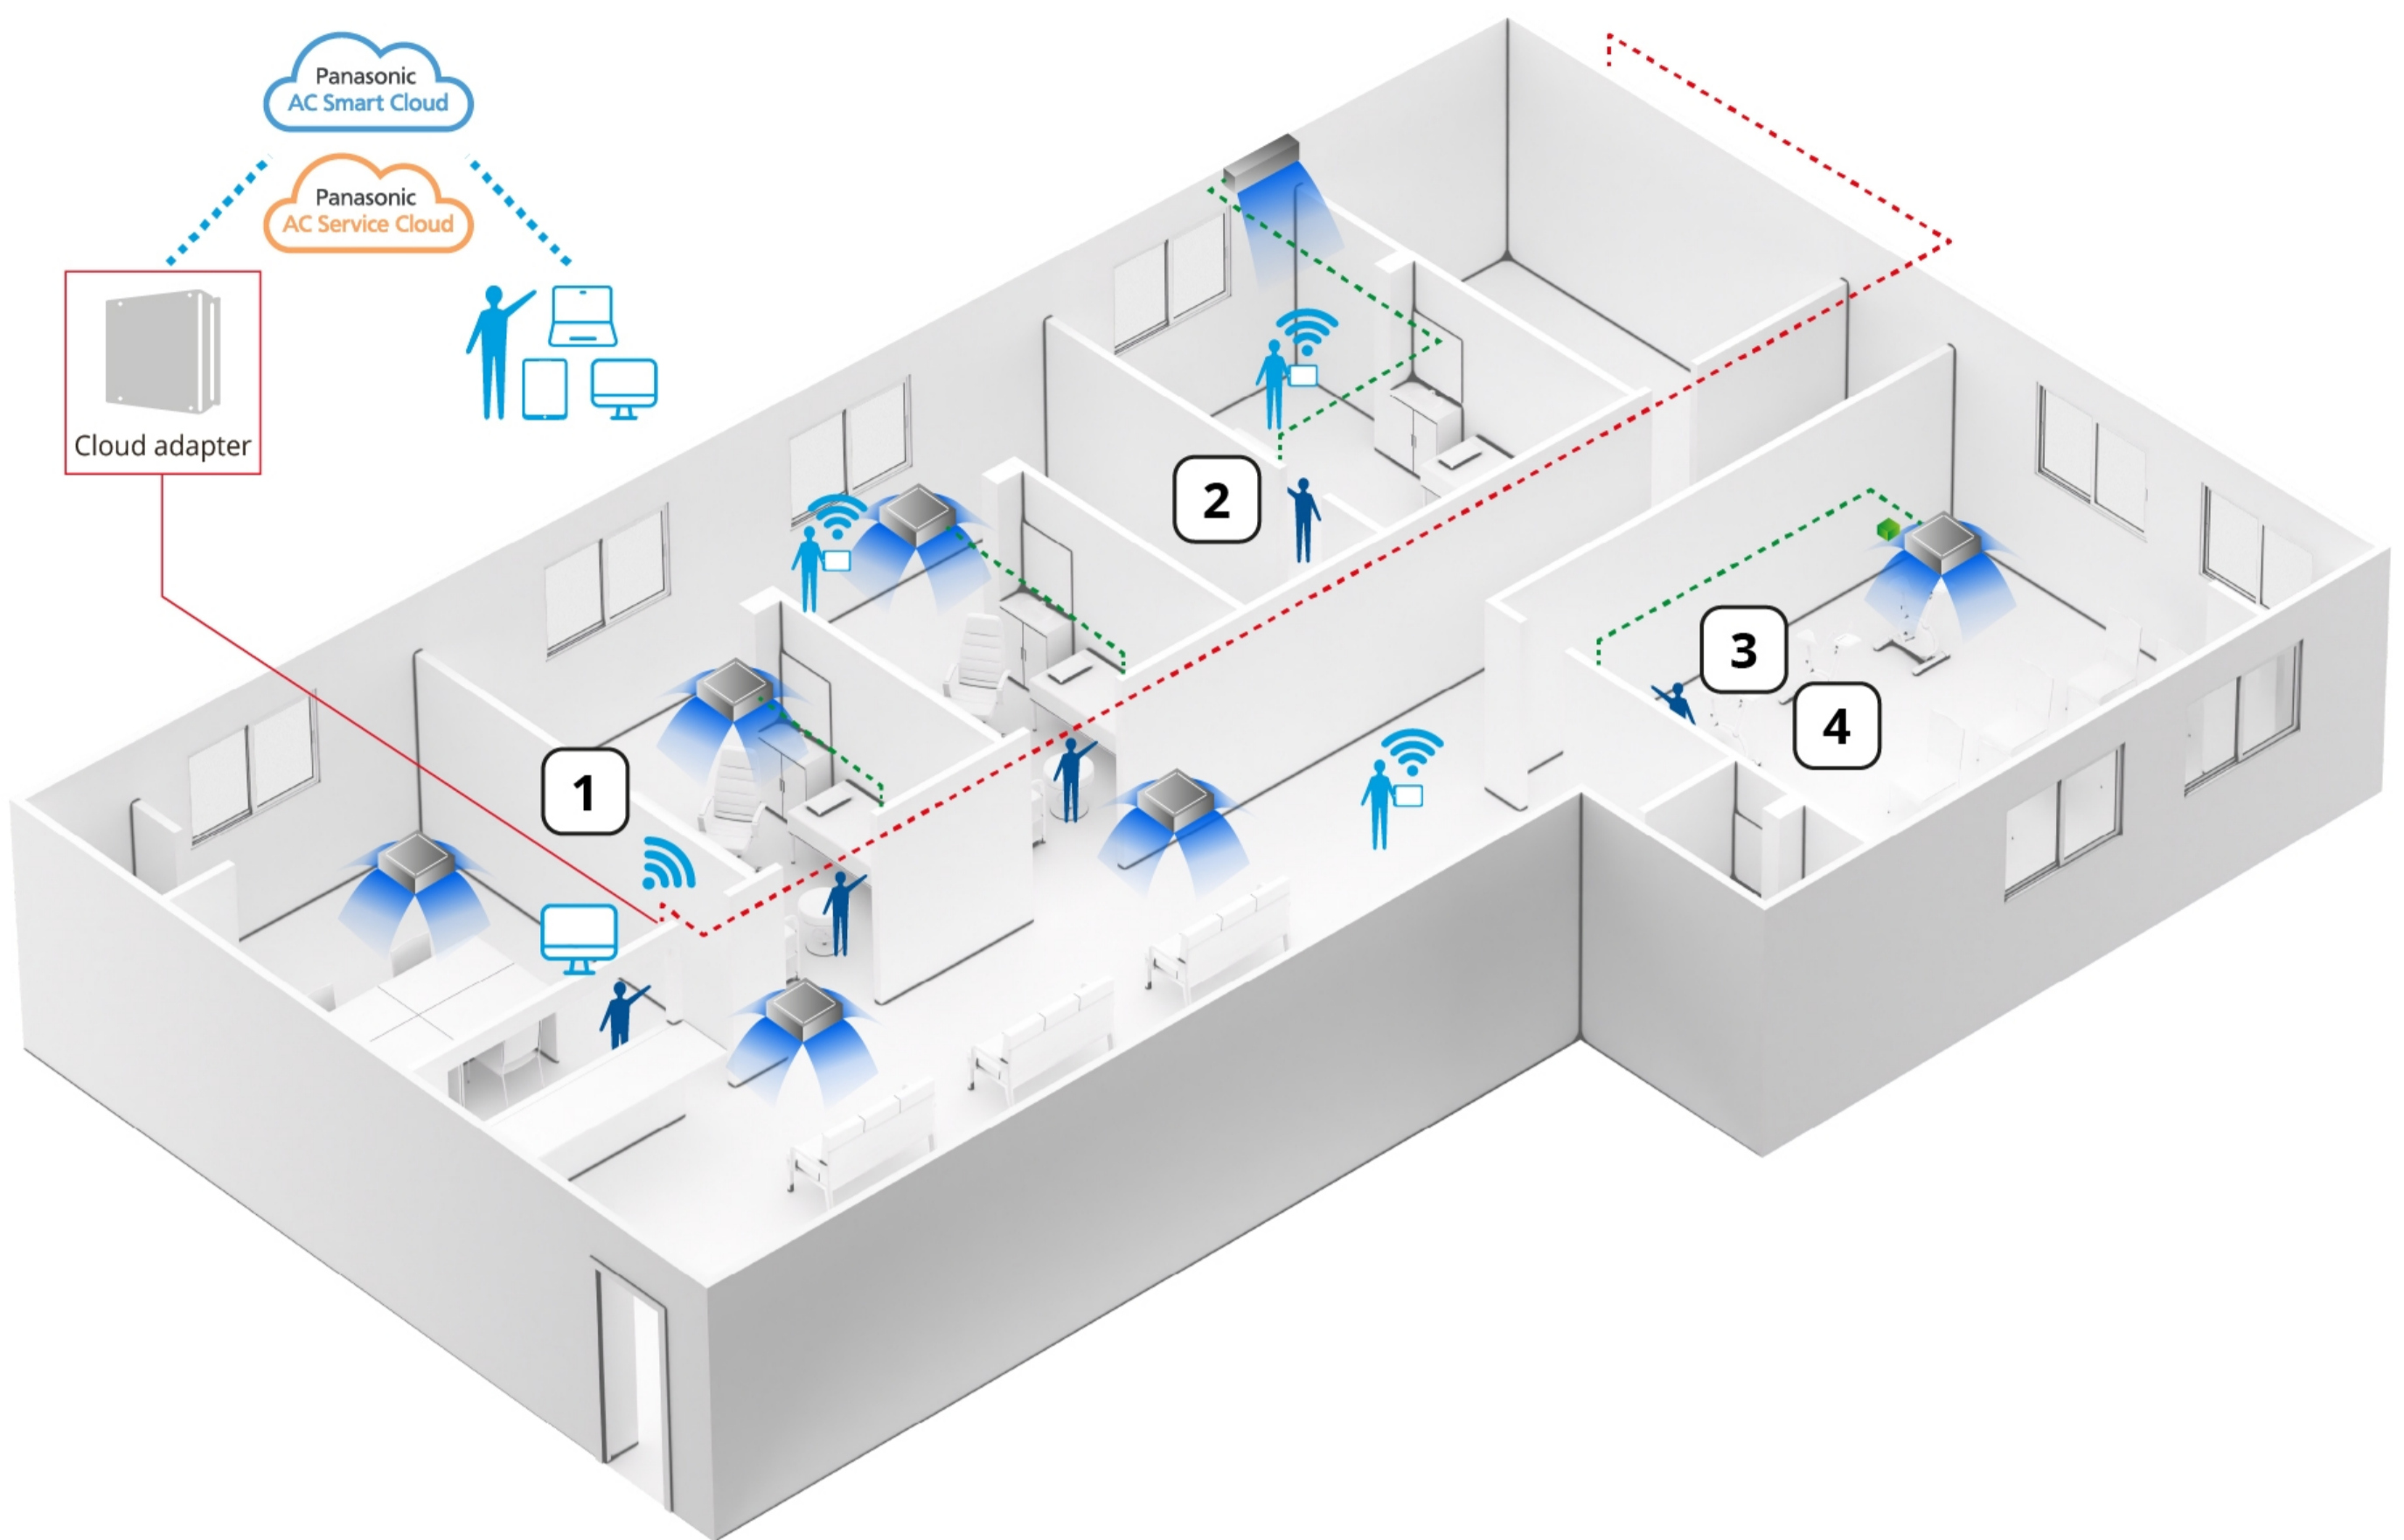
Connectivity

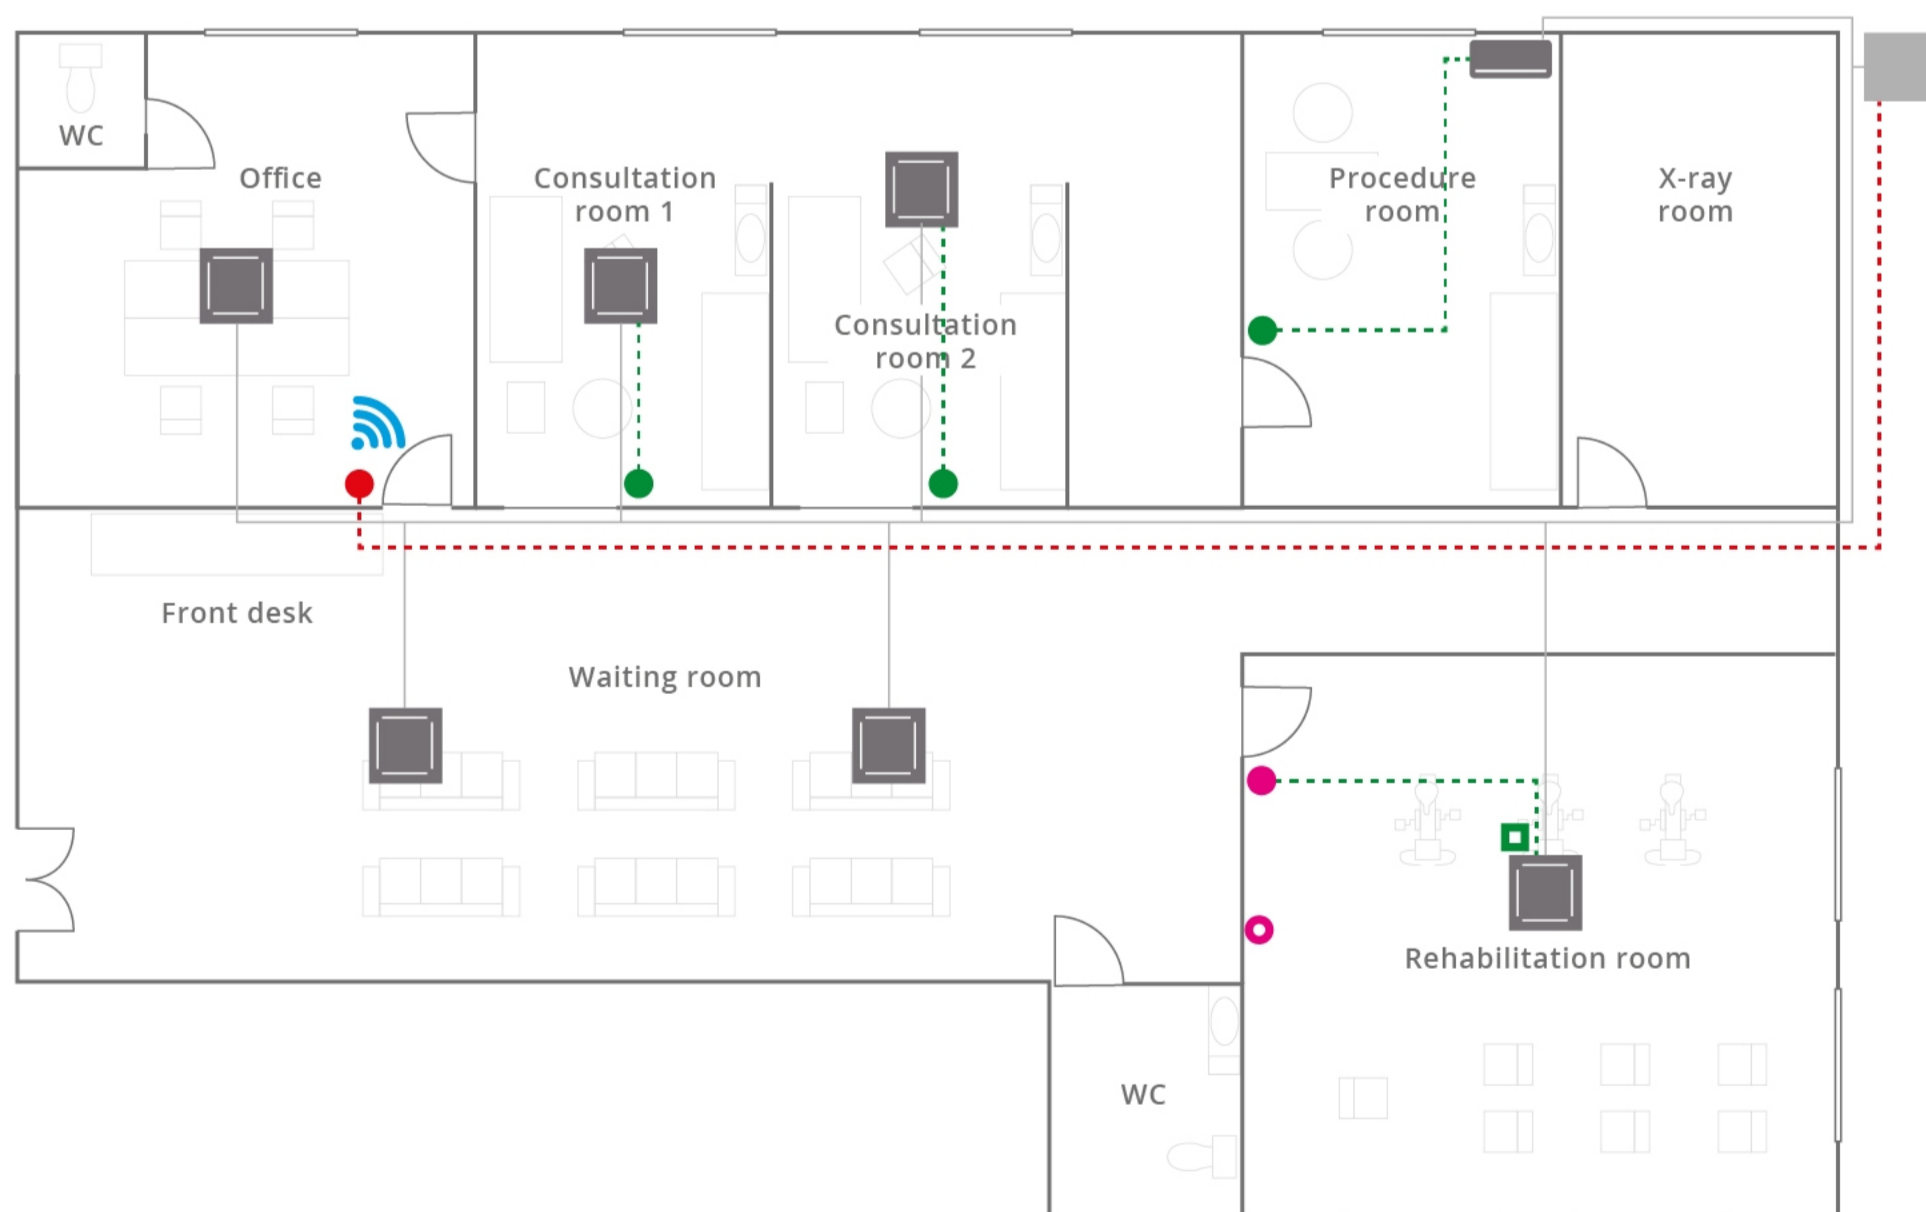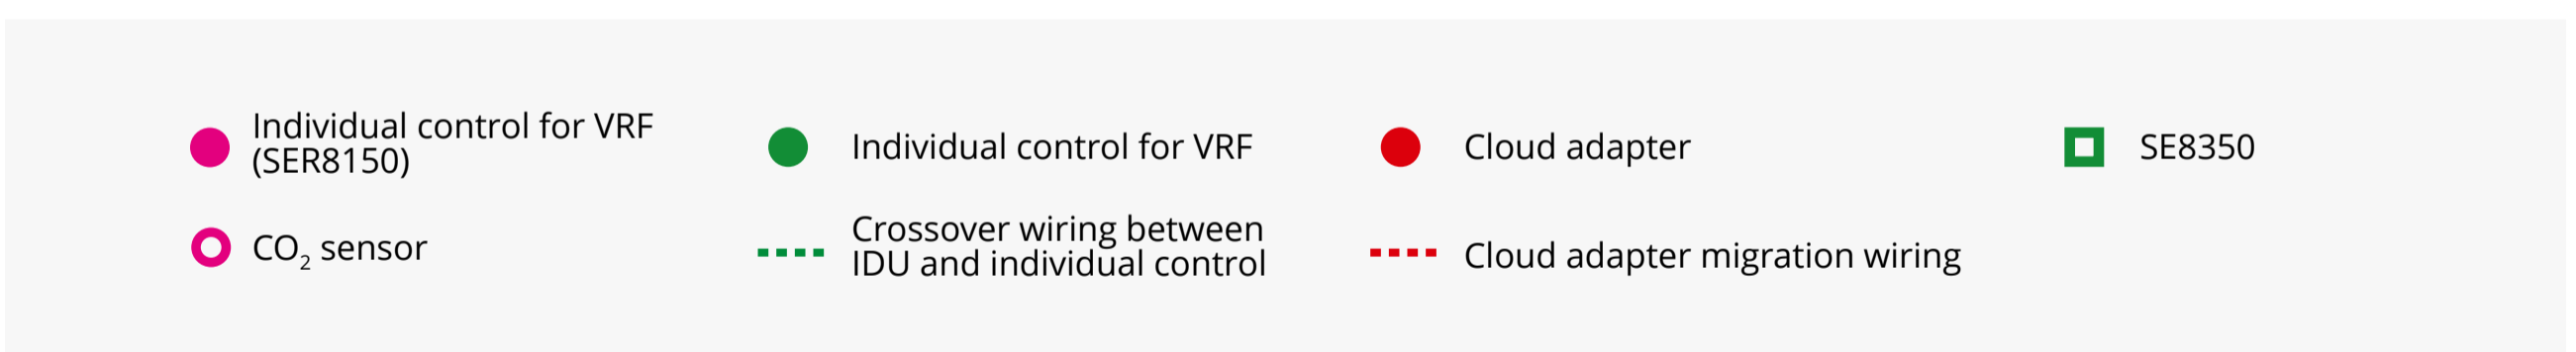| Cloud adapter	Individual control (VRF)	Individual control (VRF)	CO_2 sensor
1	2	3	4

Focused Connectivity

● Individual control for VRF (SER8150)	● Individual control for VRF	● Cloud adapter	▣ SE8350
○ CO_2 sensor	--- Crossover wiring between IDU and individual control	--- Cloud adapter migration wiring	

Floor plan labels: WC, Office, Consultation room 1, Consultation room 2, Procedure room, X-ray room, Front desk, Waiting room, Rehabilitation room, WC

Performance score

Bacteria and virus inhibition: ★★★★★★	CO_2 concentration: ★★★★★
Connectivity: ★★★★★	Deodorisation: ★★★★★
Ease of installation: ★★★★★	

Find out how we score the performance of our systems