

Test Report


nanoe™ device inhibits activity of adhered xenotropic murine leukemia virus by 99.999% in 6 hours

Test outline


- (1) Testing organisation: Charles River Biopharmaceutical Services GmbH
- (2) Test subject: Adhered xenotropic murine leukemia virus
- (3) Test volume: 45L enclosed box (350×350×400mm)
- (4) Test result: Inhibited 99.999% in 6 hours
- (5) Report No.: Virus clearance test

Test ambient

45L box

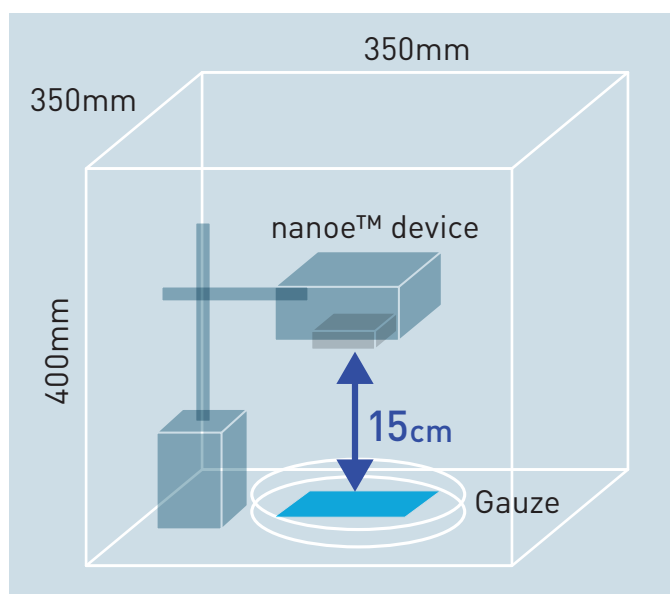

Test result

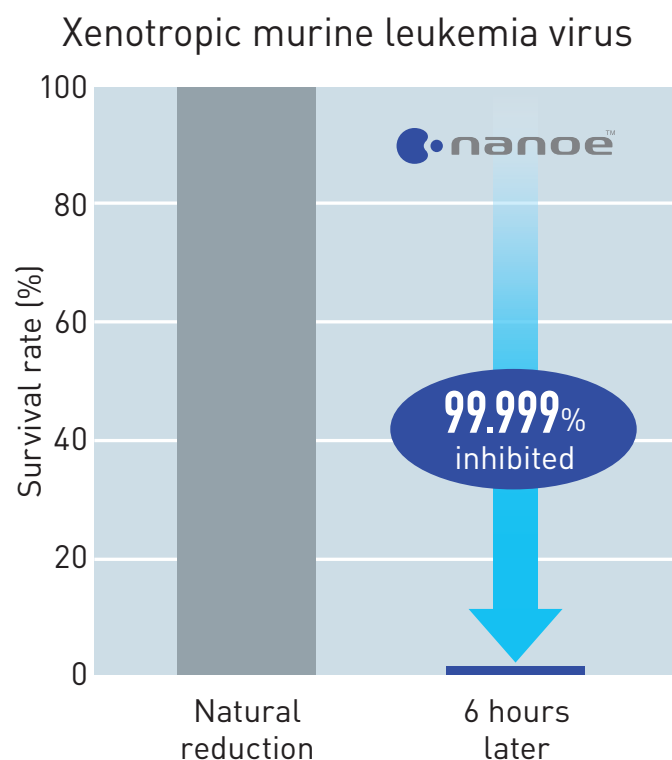

Appendix to Final Report

K1/P20/11