

Test Report


nanoe™ device inhibits activity of adhered pseudorabies virus by 99.9% in 6 hours

Test outline

- (1) Testing organisation: Charles River Biopharmaceutical Services GmbH
- (2) Test subject: Adhered pseudorabies virus
- (3) Test volume: 45L enclosed box (350×350×400mm)
- (4) Test result: Inhibited 99.9% in 6 hours
- (5) Report No.: Virus clearance test


Test ambient

45L box

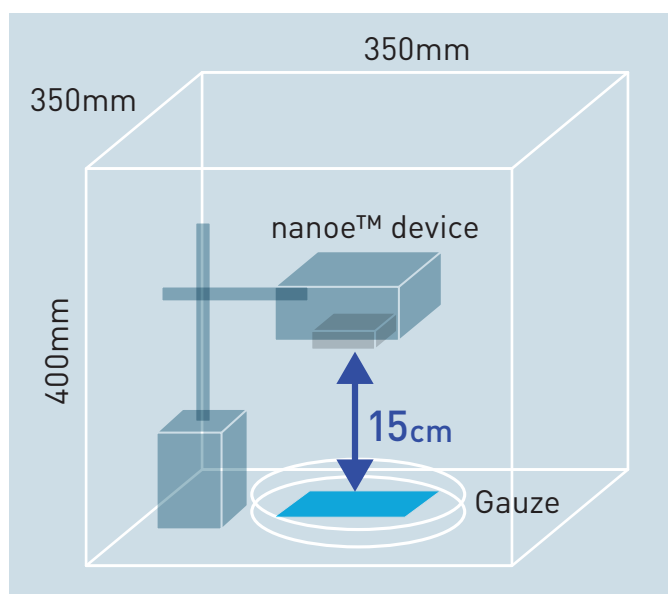

Test result

Pseudorabies virus

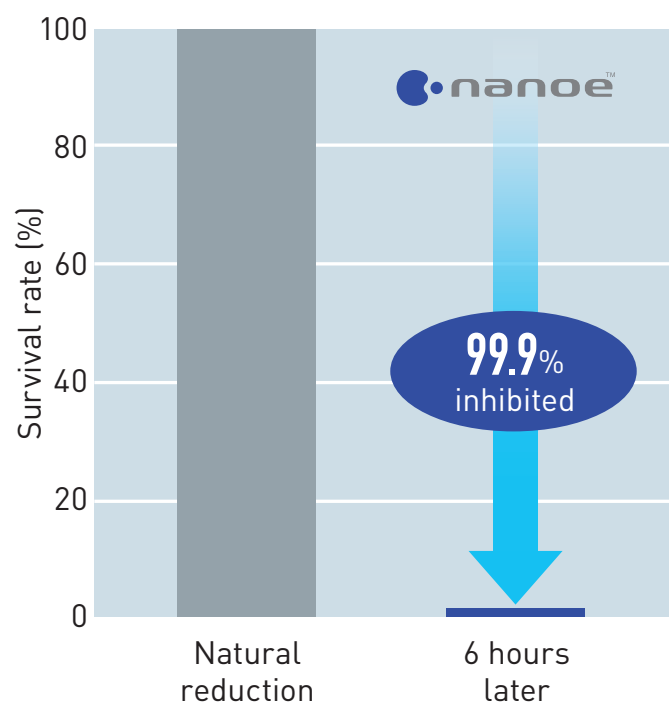

Appendix to Final Report

K1/P20/11