

Test Report


An air conditioner equipped with nanoe™ inhibits activity of airborne bacteriophage $\Phi\chi 174$ by 99.74% in 6 hours

Test outline

- (1) Testing organisation: Kitasato Research Center for Environmental Science
- (2) Test subject: Airborne bacteriophage $\Phi\chi 174$
- (3) Test volume: Approx. 25m³ laboratory (3.5×3.3×2.2m)
- (4) Test result: Inhibited 99.74% in 6 hours
- (5) Report No.: 24_0300_1


Test ambient

Approx. 25m³

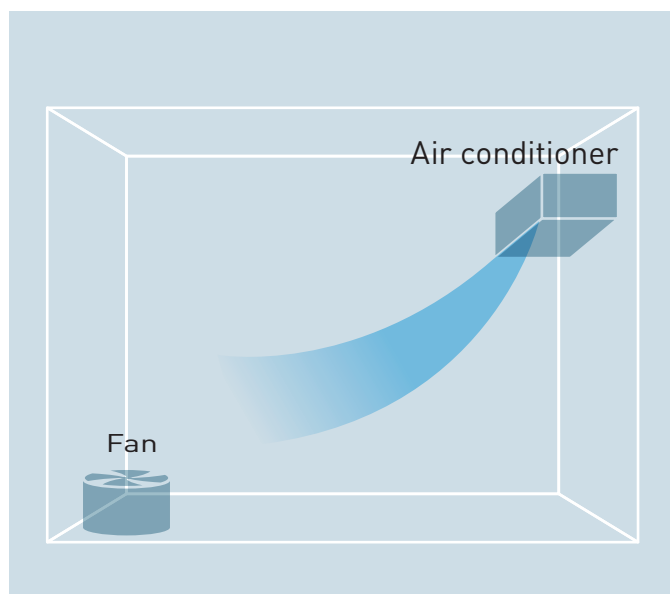

Test result

Bacteriophage $\Phi\chi 174$

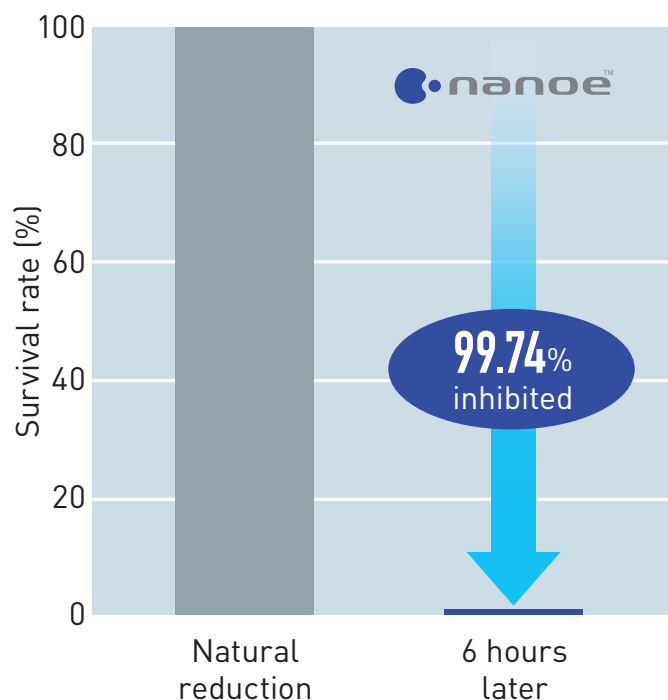

To Panasonic Corporation

Test Report

Evaluation test of the inactivation on airborne virus
(25 m³ space)

KRCES · Bio. Test Report No.24_0300_1

February 5, 2013

Approved by : Toshihiro Itoh

Toshihiro Itoh, Chief Director

Kitasato Research Center for Environmental Science

1-15-1, Kitasato, Minami, Sagamihara, Kanagawa 252-0329, Japan

The contents of this report should not be disclosed to the public without prior consent of the Kitasato Research Center for Environmental Science. The test results shown here are applied to only test samples and do not guarantee quality of the whole batch (lot) of the test material.