

Test Report

nanoe™ device inhibits activity of adhered enterohemorrhagic Escherichia coli (O157)* by 99.99% in 2 hours


*Refrigerator

Test outline

- (1) Testing organisation: Eurofins
- (2) Test subject: Adhered enterohemorrhagic Escherichia coli (O157)
- (3) Test volume: 45L enclosed box (350×350×400mm)
- (4) Test result: Inhibited 99.99% in 2 hours
- (5) Report No.: 2010/456-4


Test ambient

45L box

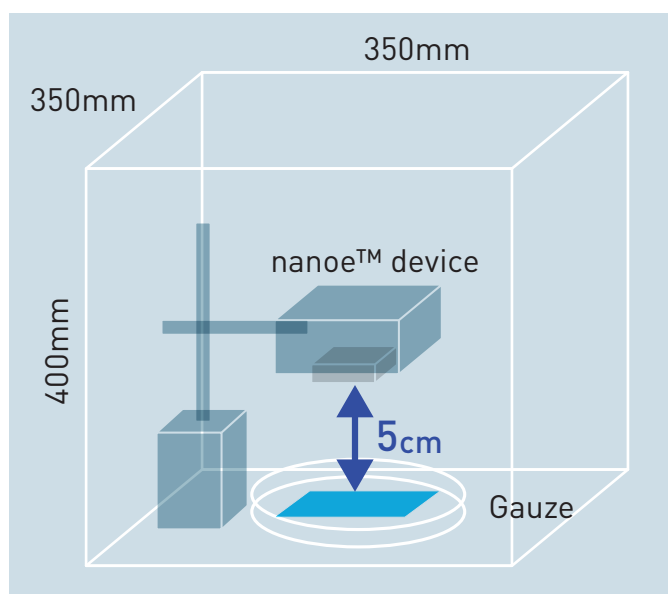

Test result

O157

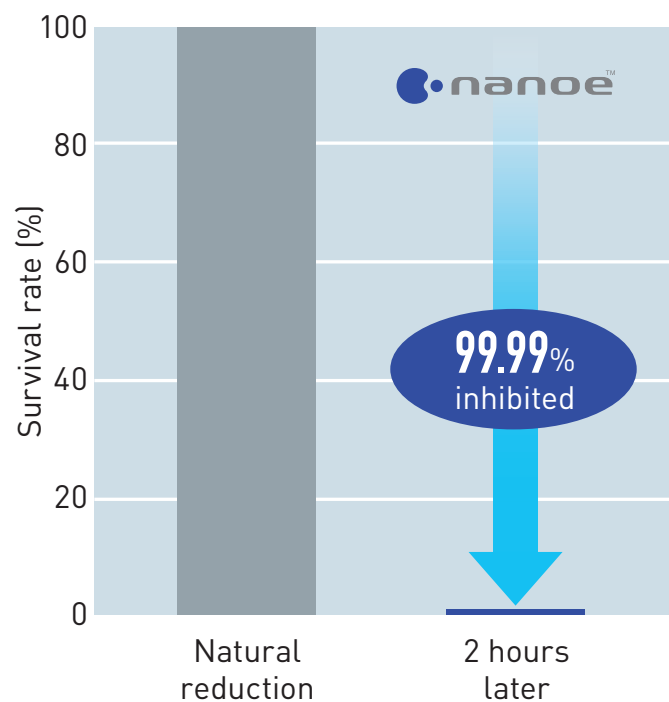



euofins

biolab

Test Facility

Report No.: 2010/456-4 SAMi Rev.2
Version: English
Page: 1 of 7
Print date: Nov 3rd 2010

Final Report 2010/456-4 SAMi Rev.2

EVALUATION OF SANITIZING EFFICACY OF NANO-SIZE ELECTROSTATIC ATOMIZED WATER PARTICLE

Study Program No: 2010/456 SAMi

Contract No PARA201001080

Sponsor: Panasonic Electric Works Co., Lt
Hans-Pinsel-Str. 2
85540 Haar, Germany

Test item: NANO-SIZE ELECTROSTATIC ATOMIZED WATER PARTICLE

Director of the Study 
(Dr. S. Viganò)

Date of issue Nov 3rd 2010

This report cannot be partially reproduced without written approval of the Test Facility.

Eurofins Biolab S.r.l.
Società con Socio unico sottoposta
a direzione e coordinamento della società
Eurofins Scientific Italia S.r.l.
parte di Eurofins Scientific Group
<http://pharma.eurofins.com/>

Via Bruno Buozzi, 2
20090 Vimodrone (MI) - Italia
Tel + 39-022507151
Fax + 39-0225071599
biolab@eurofins.com
www.eurofins.it

www.biolab.it

C SOC € 100 000 i.v
P. IVA 00762140960
C F 03765750157
REA MI 966696
D-U-N-S 429117112
CIT005 4-385