

Test Report


Air conditioner equipped with nanoe™ X inhibits activity of adhered novel coronavirus (SARS-CoV-2) over 91% in 8 hours.

Test outline

- (1) Testing organisation: Texcell (France)
- (2) Test subject: Adhered novel coronavirus (SARS-CoV-2)
- (3) Test volume: 6.7m³ room (1.7m × 1.8m × 2.2m)
- (4) Test result: Virus activity inhibited 91.4% in 8 hours
- (5) Report No.: 1140-01 C3


Test ambient

6.7 m³ (1.7×1.8×2.2m)

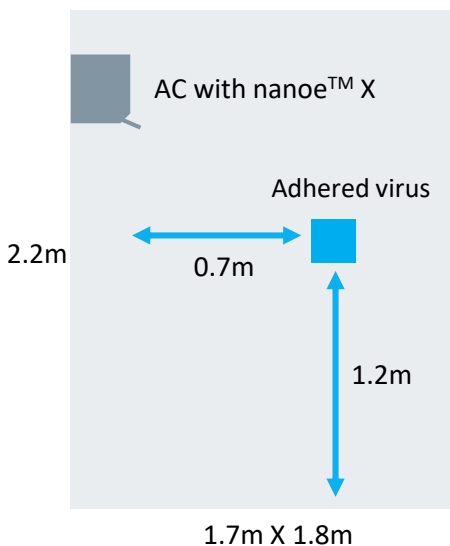

Test result

SARS-CoV-2

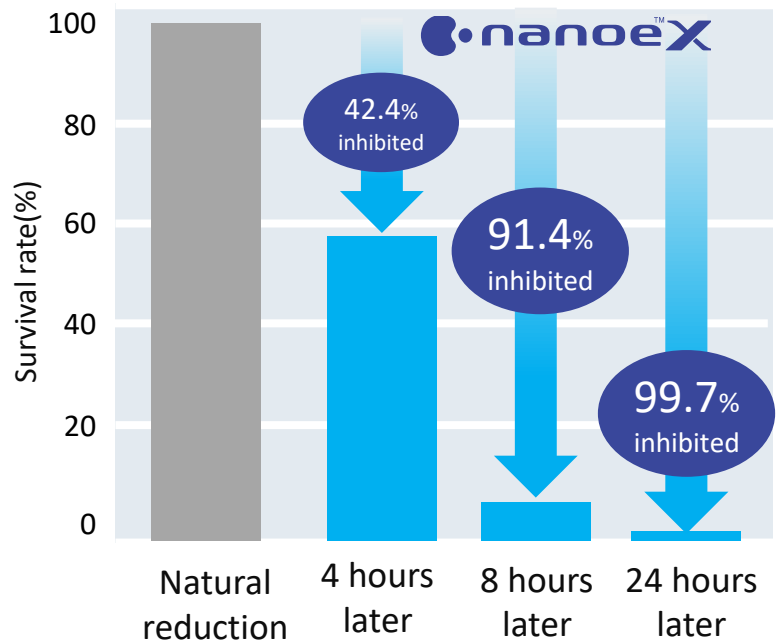

Cover page

CERTIFICATE OF INVESTIGATION STUDY

STUDY OF VALIDATION OF THE EFFICIENCY OF nanoeX+Air conditioner ON SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

Study number: 1140-01 C3

Study report for:

Sponsor: PANASONIC CORPORATION APPLIANCES COMPANY

2-3-1-2 Noji-higashi,
Kusatsu City,
Shiga 525-8555,
Japan

Submitted by:

Test Facility: TEXCELL

Test facility management: Boisson Bruno

Signature :

Genavenir 5
1 rue Pierre Fontaine
91058 Evry cedex
France



Handwritten signature of Bruno Boisson, with the text 'Boisson' and 'Coo Viral Safety' written below it.

In Panasonic conditions of use:

An inactivation and reduction titer of 1.07 Log (91.48%) of Sars-Cov-2 after 8 hours, 2.62 Log (99.76%) of Sars-Cov-2 after 24 hours was demonstrated in a 6.7m³ area – Gauze at a distance of 0.7m from the air conditioner and at a height of 1.2m