Panasonic

Test Report

ziaino®

ziaino® reduces airborne Pet odour intensity level from 5 to 0.3 in 16 hours

Test outline

(1)Testing organisation: Guangzhou Institute of Microbiology Group Co.,Ltd.

(2)Test subject: Airborne Pet odour

(3)Test volume: Approx. 81m³ laboratory (6m×4.5m×3m)

(4)Test result: Odour intensity level reduced from 5 to 0.3 in 16 hours

(5)Report No.: KJ202301267

Test ambient

Approx. 81m³

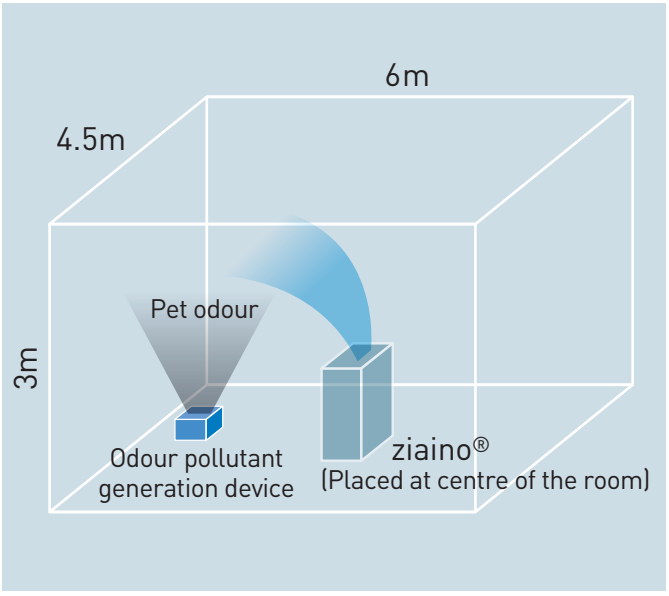

※For illustration only, diagram is not by accurate ratio

Test result

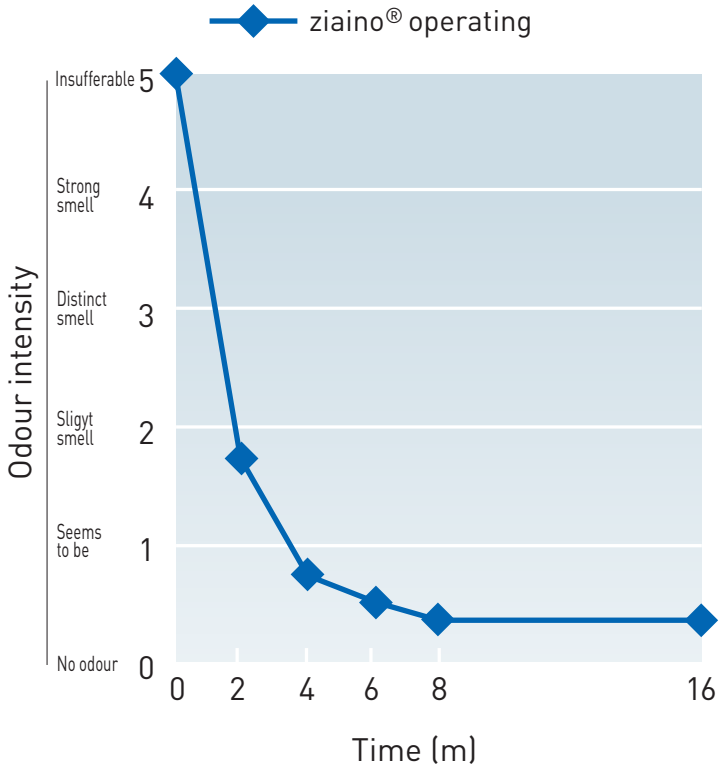

The mean value of odour intensity was calculated after removing 1maximum value and 1 minimum value from the judgment values of 6 sniffers.

广州市微生物研究所集团股份有限公司

Guangzhou Institute of Microbiology Group Co., Ltd.

国家空气净化产品质量检验检测中心

National Center of Quality Inspection and Testing on Air Purification Products

检 测 报 告

TEST REPORT

Report Number	KJ202301267
Name of Sample	ziaino® Air Treatment Unit
Applicant	Panasonic Ecology System Guangdong Co., Ltd.