

## Test Report


**nanoe™ X device inhibits activity of adhered Sterigmatocystin by 90% in 5 min**

### Test outline

- (1) Testing organisation: Panasonic Product Analysis Center
- (2) Test subject: Adhered Sterigmatocystin
- (3) Test volume: 45 L enclosed box (350×350×400mm)
- (4) Test result: Inhibited 90% in 5 min
- (5) Report No.: H24NF036-1


#### Test ambient

45 L box

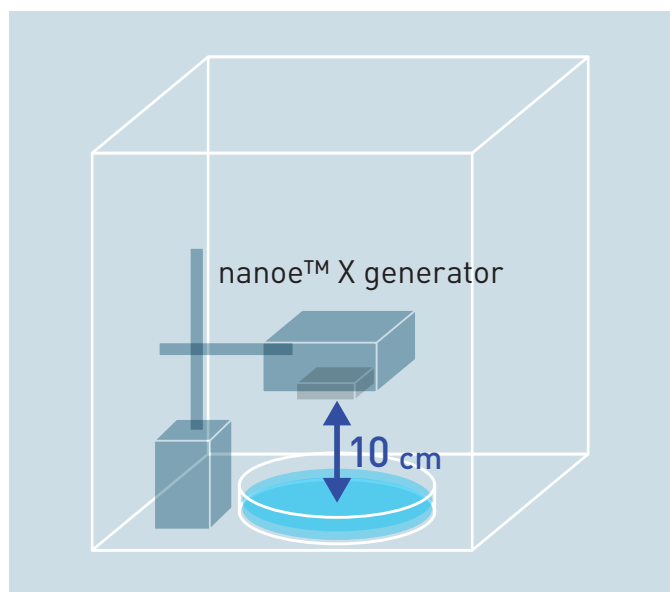

#### Test result

Sterigmatocystin

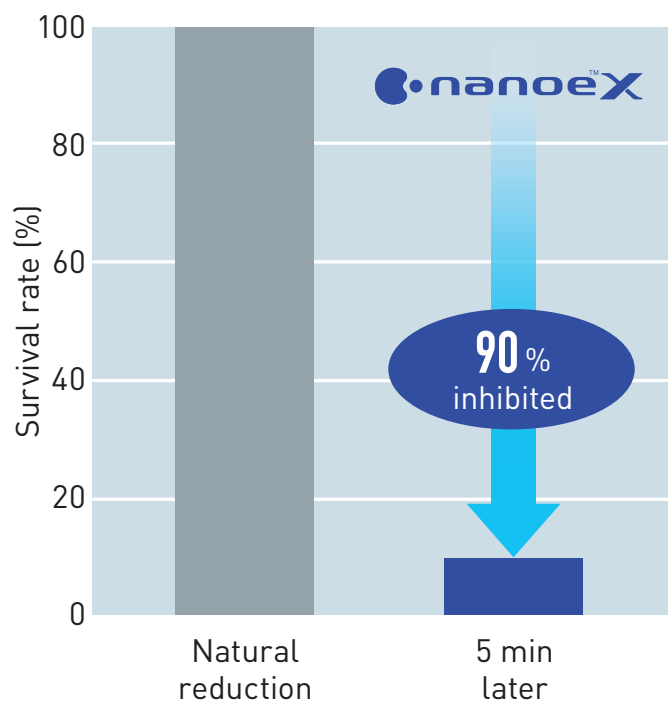

Panasonic Corporation Living Appliance Company  
Living Products Innovation Division  
Core Technology Development Center  
Attn:

## Analytical Testing Report

---


Registration Number: H24NF036-1

Title : Analysis of Mold Toxin Decomposition by Nanoe

---

Date: December 15, 2024

Panasonic Holdings Corporation  
Product Analysis Center



1048 Kadoma, Osaka 571-8686, Japan  
<https://holdings.panasonic.jp/corporate/pac/>

Chief Executive :

Misa Katsuyama

Misa Katsuyama

Person in Charge :

Kana Inagaki

Kana Inagaki

Analyst :

Narumi Fujii

Narumi Fujii