

Test Report


nanoe™ device inhibits activity of adhered enterohemorrhagic Escherichia coli (O157) by 99.9% in 2 hours

Test outline

- (1) Testing organisation: Eurofins
- (2) Test subject: Adhered enterohemorrhagic Escherichia coli (O157)
- (3) Test volume: 45L enclosed box (350×350×400mm)
- (4) Test result: Inhibited 99.9% in 2 hours
- (5) Report No.: 2010/456-3


Test ambient

45L box

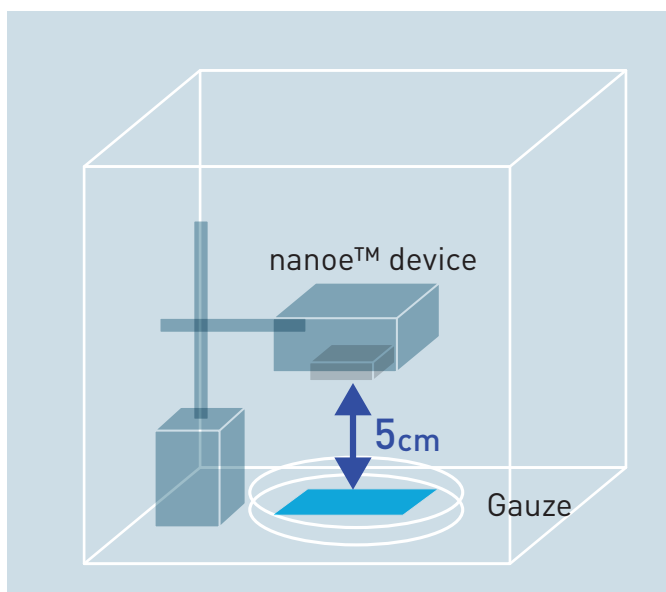

Test result

O157

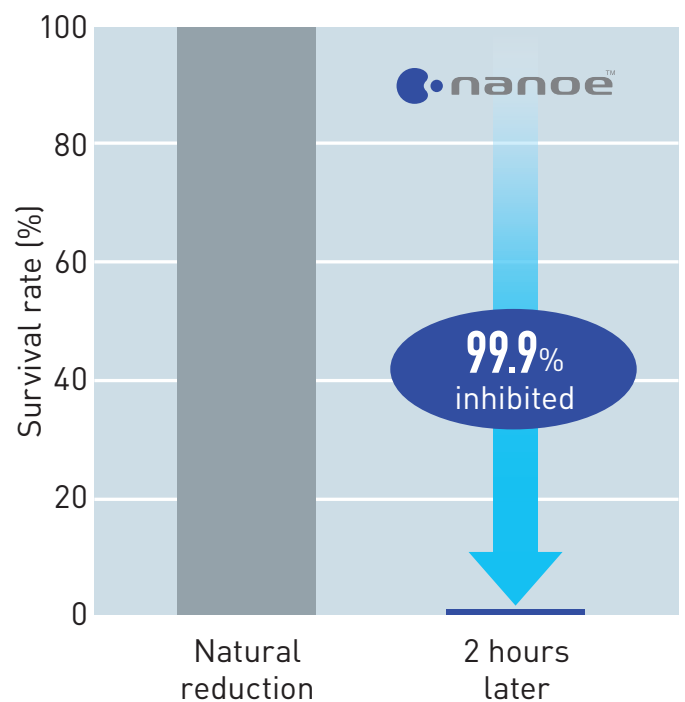

 eurofins	biolab	Test Facility	Report No.: 2010/456-3 SAMi Rev.2 Version: English Page: 1 of 6 Print date: Nov 3 rd 2010
---	---------------	----------------------	---

Final Report 2010/456-3 SAMi Rev.2

EVALUATION OF SANITIZING EFFICACY OF NANO-SIZE ELECTROSTATIC ATOMIZED WATER PARTICLE


Study Program No: 2010/456 SAMi

Contract No: PARA201001080

Sponsor: Panasonic Electric Works Co., Lt
Hans-Pinsel-Str. 2
85540 Haar, Germany

Test item: NANO-SIZE ELECTROSTATIC ATOMIZED WATER PARTICLE

Director of the Study: 

Date of issue: 

This report cannot be partially reproduced without written approval of the Test Facility.

Eurofins Biolab S.r.l.
Società con Socio unico sottoposta
a direzione e coordinamento della società
Eurofins Scientific Italia S.r.l.
parte di Eurofins Scientific Group
<http://pharma.eurofins.com/>

Via Bruno Buozzi, 2
20090 Vimodrone (MI) - Italia
Tel. + 39-022507151
Fax + 39-0225071599
biolab@eurofins.com
www.eurofins.it www.biolab.it

C.SOC. € 100.000 i.v.
P. IVA 00762140960
C.F. 03765750157
REA MI 966696
D-U-N-S 429117112
CIT005 4-385