

Test Report


An air conditioner equipped with nanoe™ X (Mark 3) inhibits activity of adhered MS2 Phage Virus by 99.99% in 2 hours

Test outline

- (1) Testing organisation: Shokukanken, Inc.
- (2) Test subject: Adhered MS2 Phage Virus
- (3) Test volume: Approx. 25m³ laboratory
- (4) Test result: Inhibited 99.99% in 2 hours
- (5) Report No.: 227131N


Test ambient

Approx. 25m³

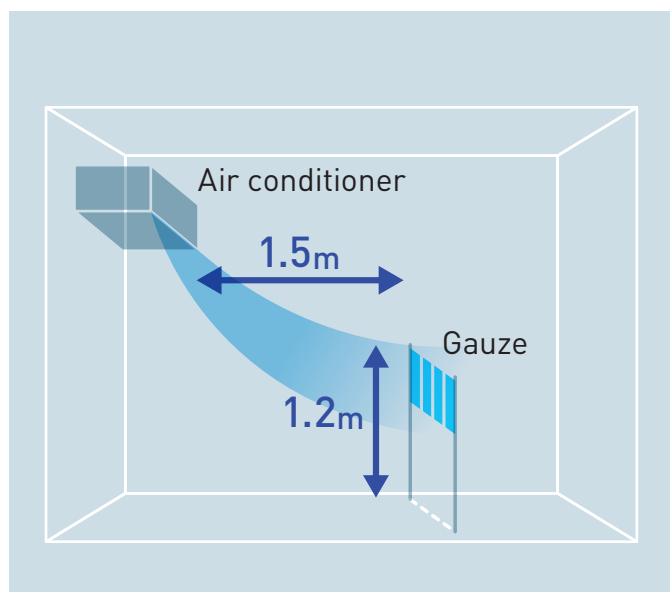

Test result

MS2 Phage Virus

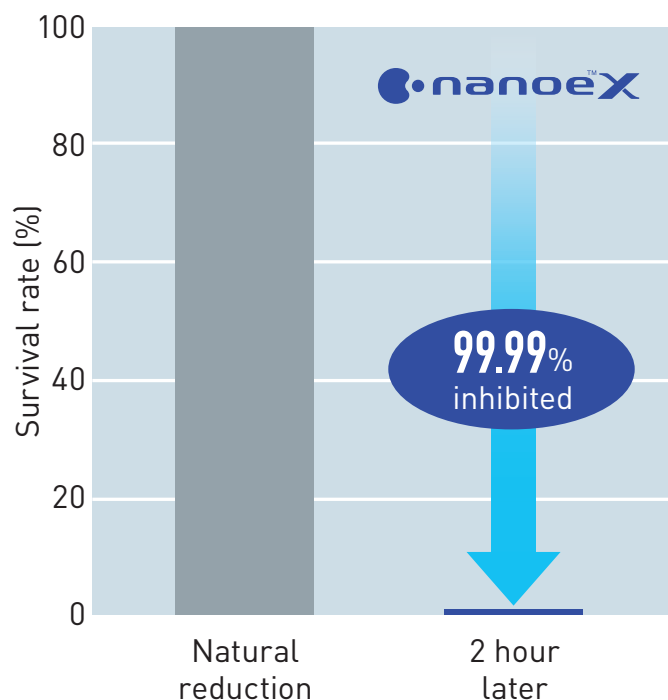

—Study Report—

Confirmation Test of Inhibitory Effect by Equipment on Adhered Virus

Study Number : 227131N

Study Results

The Air Conditioner with Nanoe™ X Decreased Adhered MS2 Phage Virus
by 99.99% in 2 Hours.

15 July, 2022



Shokukanken, Inc.

561-21 Araguchi-machi, Machashi, Gunma, 379-2107, Japan

Tel:027-230-3411

Fax:027-230-3412