

## Test Report


**An air conditioner equipped with nanoe™ X reduces cigarette smoke odour intensity by 0.7 levels in 2 hours**

### Test outline

- (1) Testing organisation: Kaken Test Center
- (2) Test subject: Adhered cigarette smoke odour
- (3) Test volume: Approx. 139m<sup>2</sup> laboratory (20×7×2.7m)
- (4) Test result: Odour intensity reduced 0.7 levels in 2 hours
- (5) Report No.: KT-19-015089-2


### Test ambient

Approx. 139m<sup>2</sup>

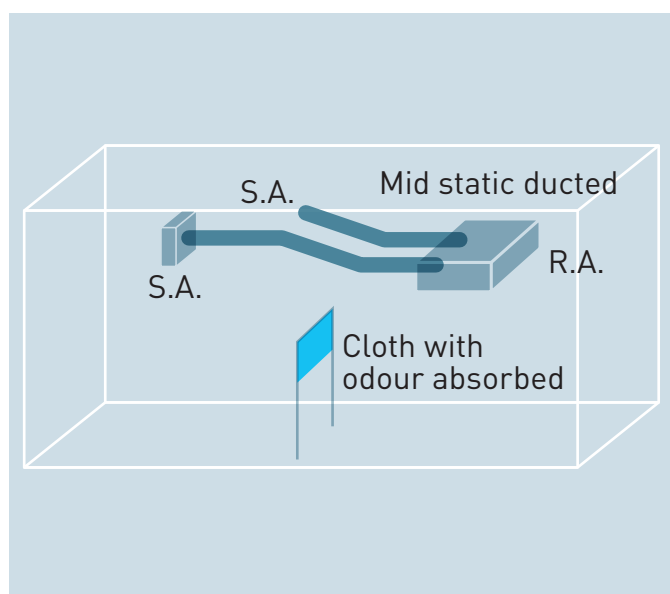

### Test result

Cigarette smoke odour

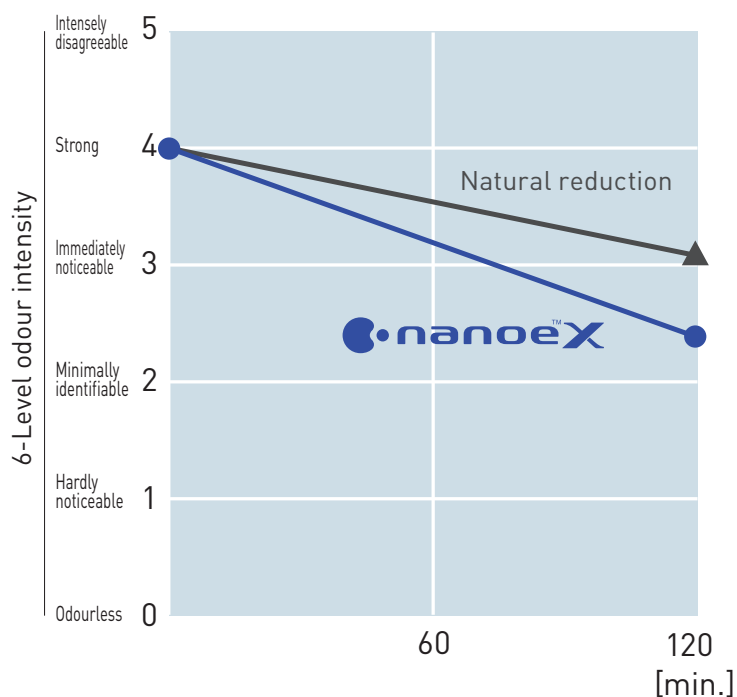

2019年11月15日

# 業務連絡書

依頼者：パナソニック 株式会社 殿

品名：S-140PF3E (20倍ナノイー搭載 中静圧ダクト室内機)

KT-19-15089-2の試験について



以下のようにご連絡申し上げます。

〒604-8431 京都市中京区西ノ京原町67番地1

一般財団法人 **カケンテストセンター**  
京都検査所

Tel (075)-802-7272 Fax (075)-802-7282



記

補足：

- ・2時間作動後、ブランクより臭気強度が低減した。
- ・ブランクと比較し、2時間作動後は不快度が軽減（刺激臭、焦げ臭が軽減）した。

以上