

Test Report


An air conditioner equipped with nanoe™ X inhibits adhered novel coronavirus (SARS-CoV-2) by 91.4% in 8 hours

Test outline


- (1) Testing organisation: Texcell (France)
- (2) Test subject: Adhered novel coronavirus (SARS-CoV-2)
- (3) Test volume: Approx. 6.7 m³ laboratory
- (4) Test result: Inhibited 91.4% in 8 hours
- (5) Report No.: 1140-01 C3

Test ambient

Approx. 6.7 m³

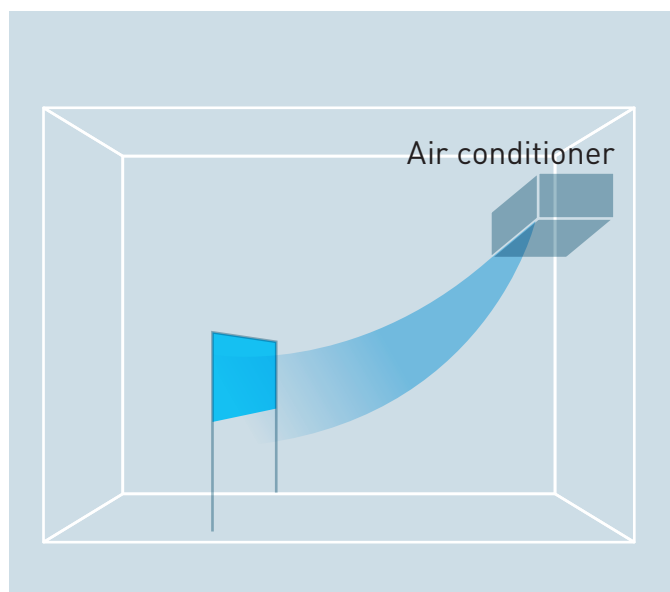

Test result

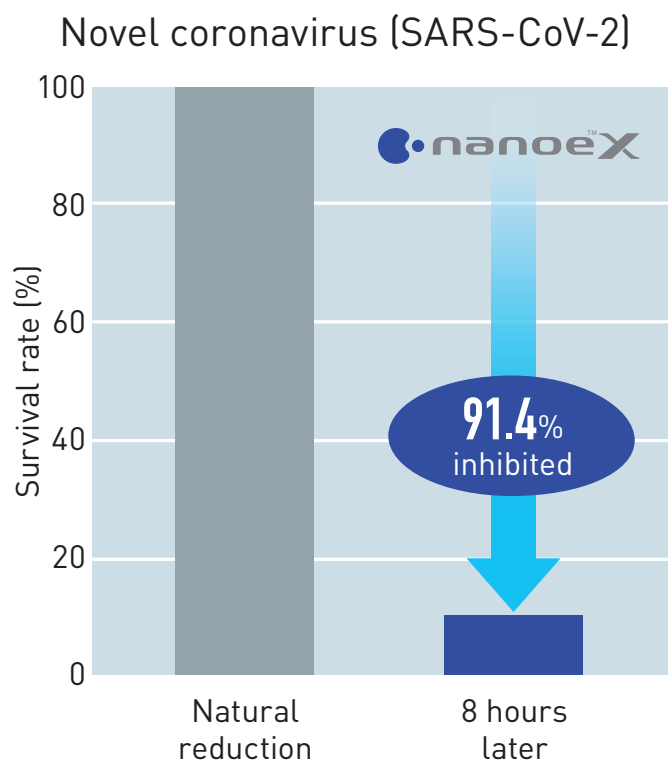

CERTIFICATE OF INVESTIGATION STUDY

STUDY OF VALIDATION OF THE EFFICIENCY OF nanoeX+Air conditioner ON SARS-COV2 BY NO GLP VIRAL CLEARANCE STUDY (FIO)

Study number: 1140-01 C3

Study report for:

Sponsor: PANASONIC CORPORATION APPLIANCES COMPANY

2-3-1-2 Noji-higashi,
Kusatsu City,
Shiga 525-8555,
Japan

Submitted by:

Test Facility: TEXCELL

Test facility management: Boisson Bruno

Signature :

Genavenir 5
1 rue Pierre Fontaine
91058 Evry cedex
France



Handwritten signature of Bruno Boisson, with the text 'Boisson' and 'Core Viral Safety' written below it.

In Panasonic conditions of use:

An inactivation and reduction titer of 1.07 Log (91.48%) of Sars-Cov-2 after 8 hours, 2.62 Log (99.76%) of Sars-Cov-2 after 24 hours was demonstrated in a 6.7m³ area – Gauze at a distance of 0.7m from the air conditioner and at a height of 1.2m