



## Dimension

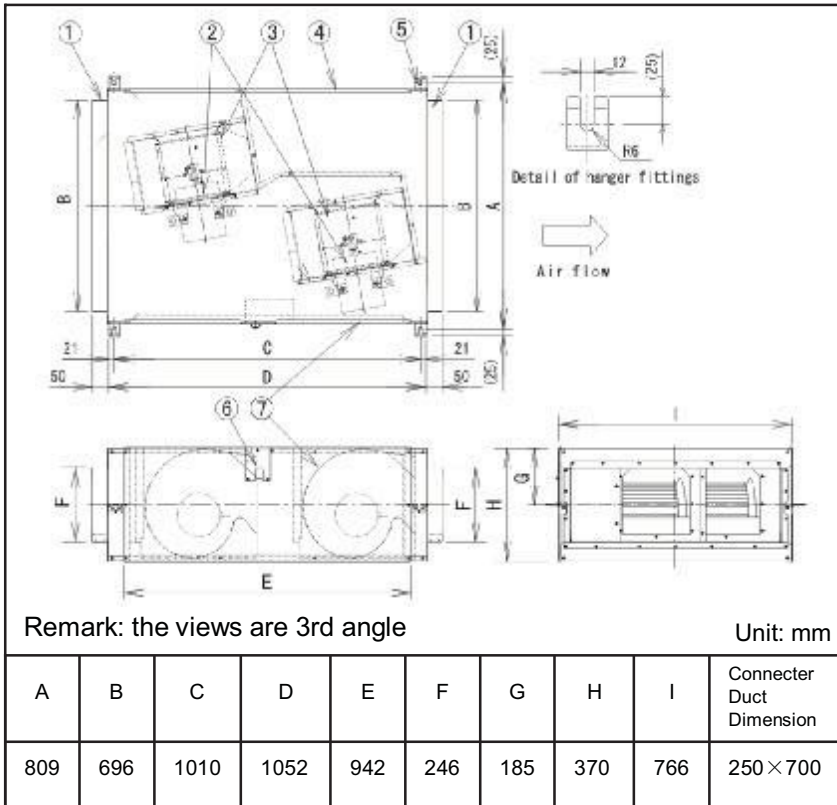

## Parts List

No.	Part name	Q'ty	Material
1	Adapter	2	Metal
2	Motor	2	—
3	Impeller	2	Metal
4	Frame	1	Metal
5	Hanger fitting	4	Metal
6	Terminal cover	1	Metal
7	Inspection panel	1	Metal

## Wiring Diagram

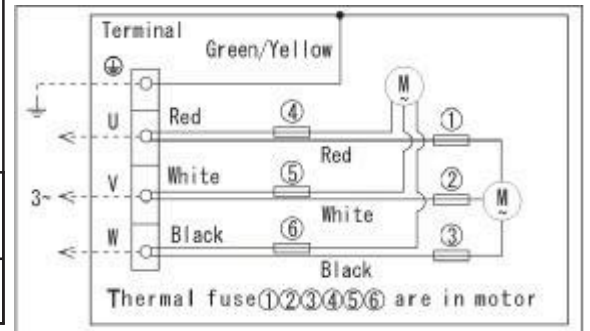




## Specification

Power Rating V/Hz	3~ 380/50	3~ 415/50	3~ 440/50	3~ 380/60	3~ 220/60	3~ 230/60
Air Volume m <sup>3</sup> /h(±10%)	5200			5500	5800	
Static pressure Pa (≥90%)	470			680	730	
Noise Level dB(A) +3dB,-7dB	45			46	48	
Consumption W(±15%)	1180	1260		1750	1980	
Current A (±15%)	2.3			3.2	6.3	
Net Weight kg	60					

### Notes:


- ① The values of rated input, air volume and noise are specified at the static pressure of 0 Pa.
- ② The values of noise level is A weighted average sound pressure level, the mean value are measured by our company.
- ③ The values of noise level are measured at the 1.5m apart from the side of the fan body when ducts are connected on both inlet and outlet side. It's on the assumption that the noise of fan body propagates to the room inside.

## P-Q Curve

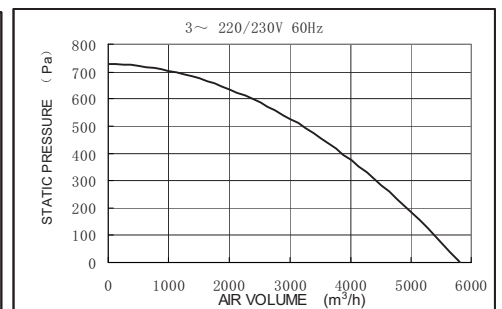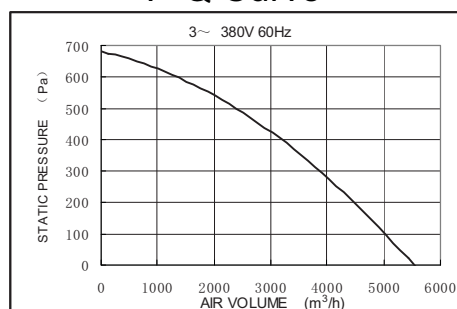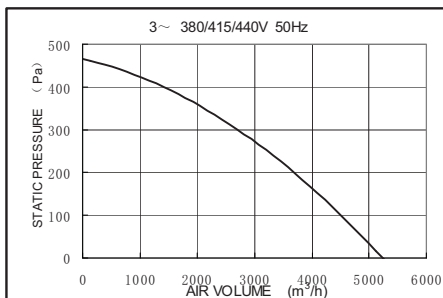

Product		Model	
CAB/F		FV-25SM3	
Make Date	2011.05.10	Scale	Drawing No. CAB11012
Modification Date		Free	Modification No.
Panasonic Ecology Systems Guangdong Co., Ltd.			


## Dimension

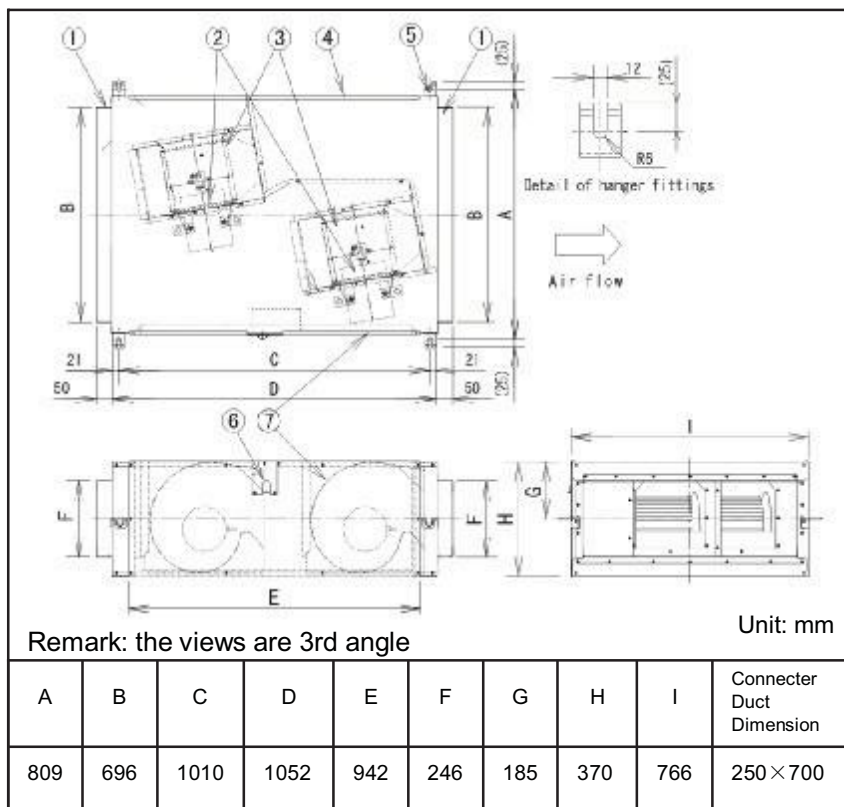

## Parts List

No.	Part name	Q'ty	Material
1	Adapter	2	Metal
2	Motor	2	—
3	Impeller	2	Metal
4	Frame	1	Metal
5	Hanger fitting	4	Metal
6	Terminal cover	1	Metal
7	Inspection panel	1	Metal


## Wiring Diagram

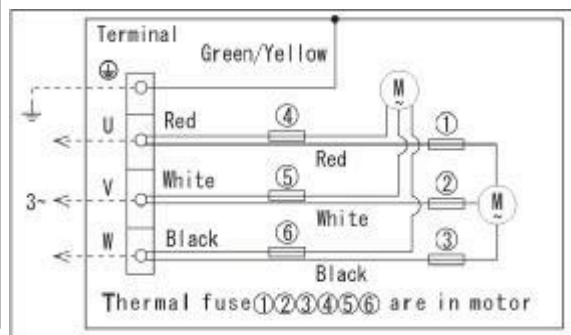

## Specification

Power Rating	V/Hz	3~ 220/60	3~ 230/60
Air Volume	m <sup>3</sup> /h(±10%)	5800	
Static pressure	Pa (≥90%)	730	
Noise Level	dB(A) +3dB,-7dB	48	
Consumption	W(±15%)	1980	
Current	A (±15%)	6.3	
Net Weight	kg	60	

## P-Q Curve

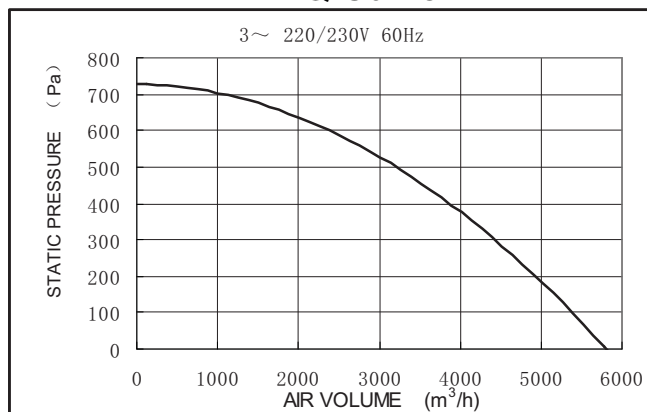

### Notes:

①The values of rated input, air volume and noise are specified at the static pressure of 0 Pa.

②The values of noise level is A weighted average sound pressure level, the mean value are measured by our company.

③The values of noise level are measured at the 1.5m apart from the side of the fan body when ducts are connected on both inlet and outlet side. It's on the assumption that the noise of fan body propagates to the room inside.

Product			Model	
CAB/F			FV-25SM3 22	
Make Date	2011.05.10	Scale	Drawing No.	CAB11013
Modification Date		Free	Modification No.	
Panasonic Ecology Systems Guangdong Co., Ltd.				